

Blue Jeans Cable

Network Cable Test Report -- for more details, protocols, etc. see
www.bluejeanscable.com/networkcablereports.htm



Cable ID: OCV-50F

Date / Time: 07/23/2013 10:05:37 AM

Headroom 0.6 dB (NEXT 45-78)

Test Limit: ISO Patch Cord Cat6A 15.0m

Cable Type: Cat 6A FTP

Operator: BJC

Software Version: 2.7400

Limits Version: 1.9300

NVP: 74.0%

Test Summary: FAIL

Model: DTX-1800


Main S/N: 2300619

Remote S/N: 2300620


Main Adapter: DTX-PC6A/MN ISO/IEC

Remote Adapter: DTX-PC6A/SR ISO/IEC


Wire Map	1	2	3	4	5	6	7	8	S
PASS									
(T568B)	1	2	3	4	5	6	7	8	S




Length (ft)	[Pair 78]	54
Prop. Delay (ns)	[Pair 36]	79
Delay Skew (ns)	[Pair 36]	5
Resistance (ohms)	[Pair 36]	3.0

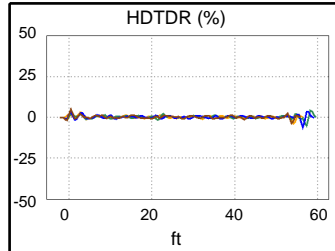

	Worst Case Margin		Worst Case Value	
PASS	MAIN	SR	MAIN	SR
Worst Pair	45-78	45-78		
NEXT (dB)	0.6*	0.6		
Freq. (MHz)	486.0	486.0		
Limit (dB)	32.2	32.2		

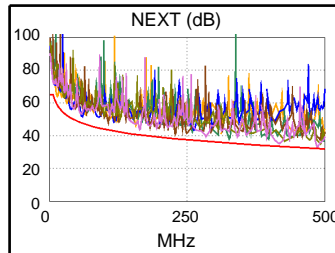

FAIL	MAIN	SR	MAIN	SR
Worst Pair	78	36		
RL (dB)	-1.7F	-1.1		
Freq. (MHz)	301.0	455.0		
Limit (dB)	12.8	10.1		

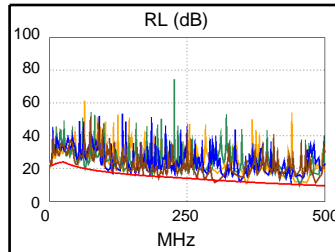

* Measurement is within the accuracy limits of the instrument.